



Article 11 of LWR Licence

- Subject to Article 10 hereof, but notwithstanding any other terms or conditions of this Interim Licence, the Licencee shall operate the said control structure at Jenpeg in such a manner that **any increase or decrease in the rate of the discharge there from during any 24 hour period shall not exceed 15,000 cubic feet per second.**

Jenpeg 15,000 cfs Rate of Change Limit

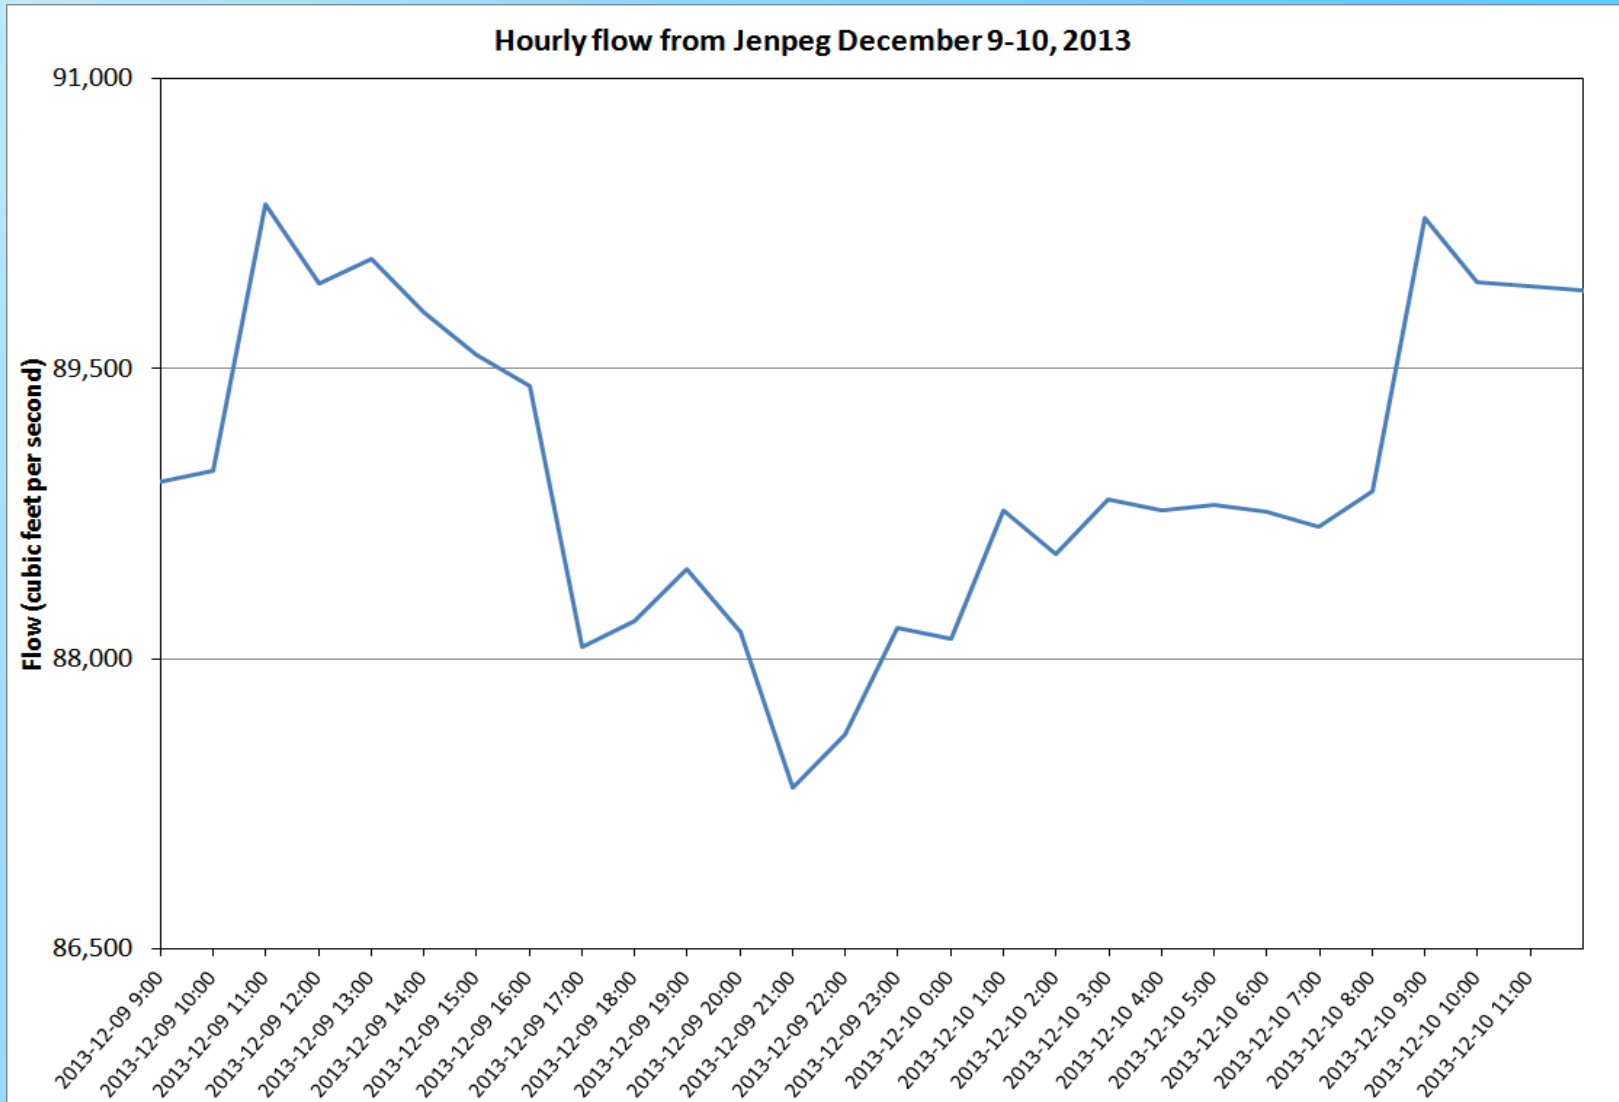

Jenpeg 15,000 cfs Rate of Change Limit

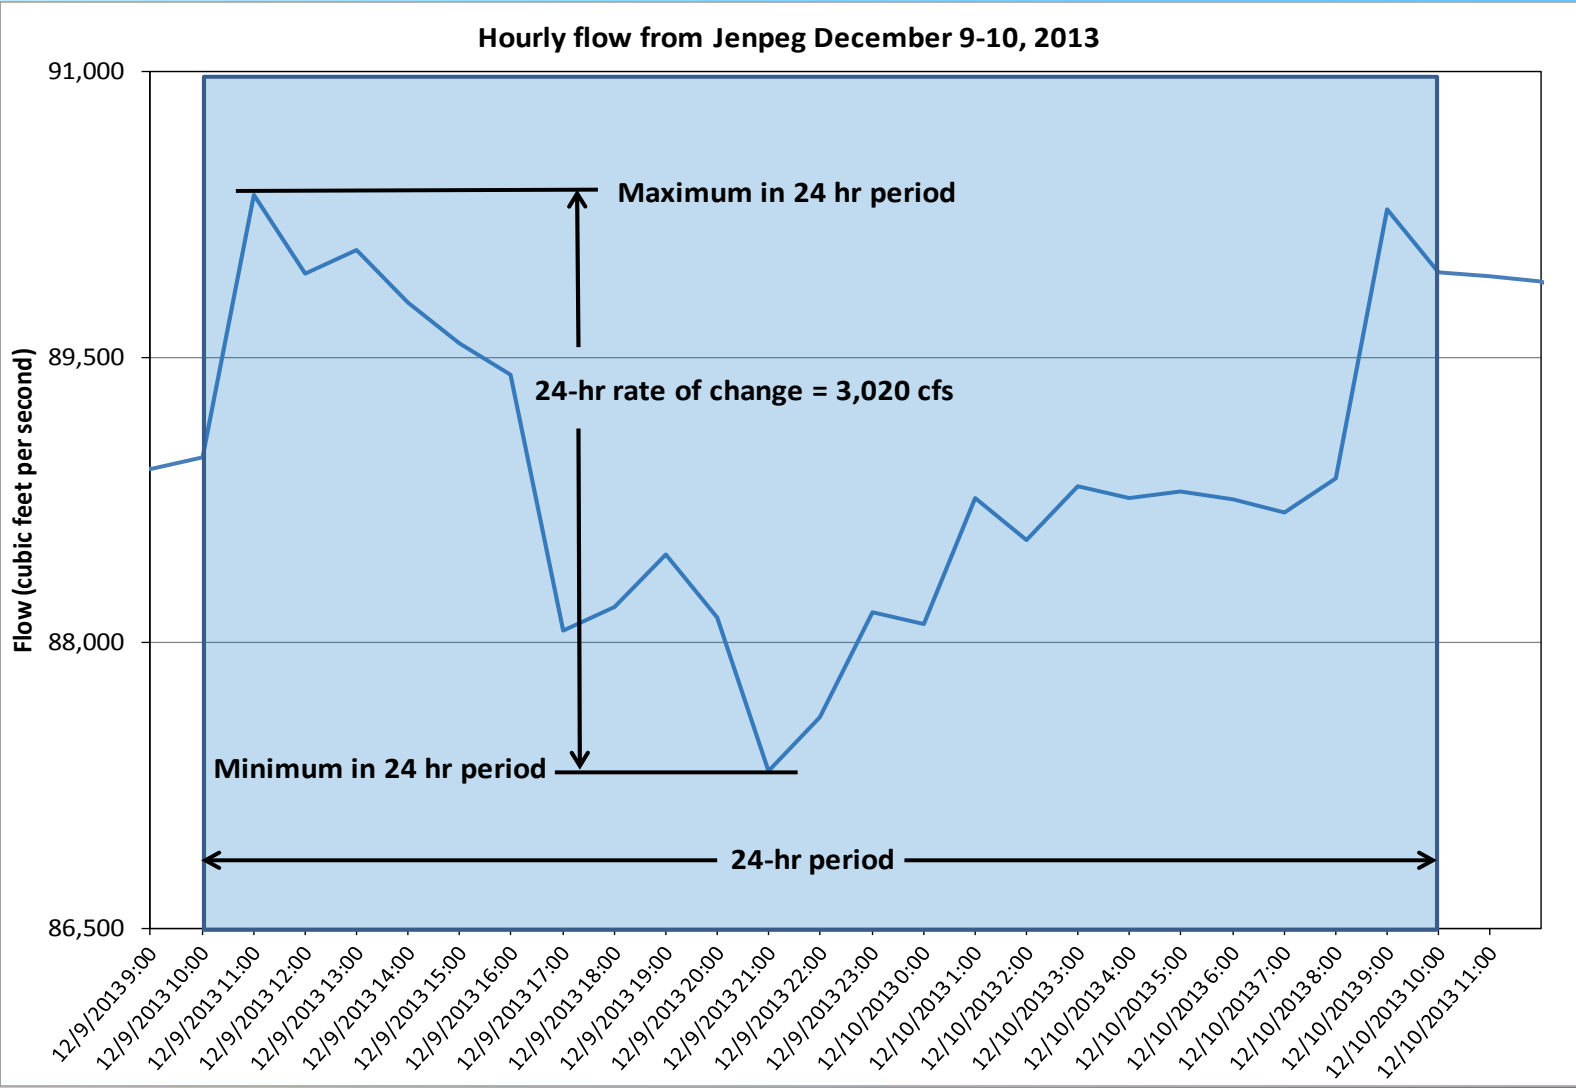

Cross Lake Open Water Variations Within 7-days

Weekly Variation Statistic	Pre-LWR (ft)	Post-LWR, Post-Weir (ft)	Difference (ft)
Average	0.2	0.3	0.1
Maximum	1.8	1.9	0.1

LW Levels and Cross Lake Outflows Actual and With LWR Removed

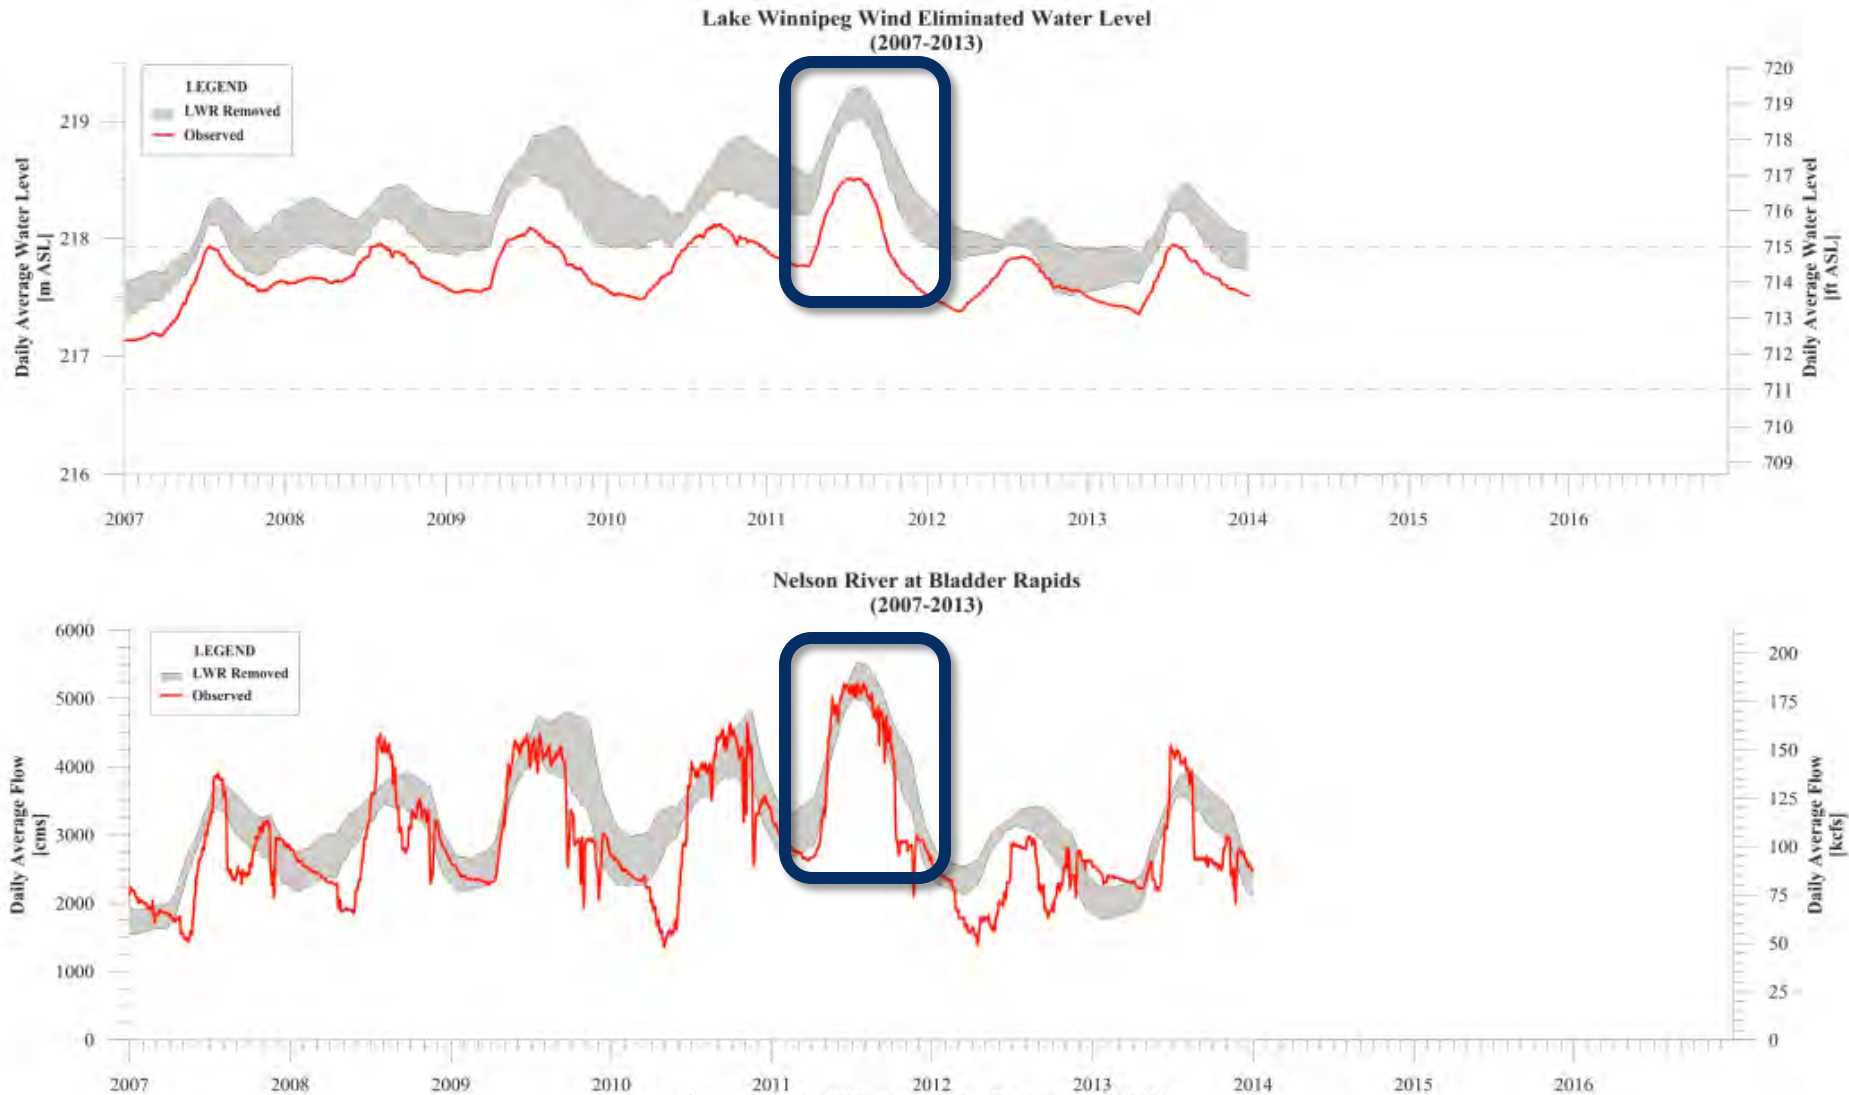


Figure 10: Lake Winnipeg Water Regime (2007-2013)

Split Lake Water Variations Within 7-days

Period	Weekly Variation Statistic	Pre-LWR (ft)	Post-LWR (ft)	Difference (ft)
Open Water	Average	0.2	0.3	0.1
	Maximum	1.5	2.0	0.6
Winter	Average	0.3	0.4	0.1
	Maximum	2.8	2.2	-0.6